


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 03-09-2015

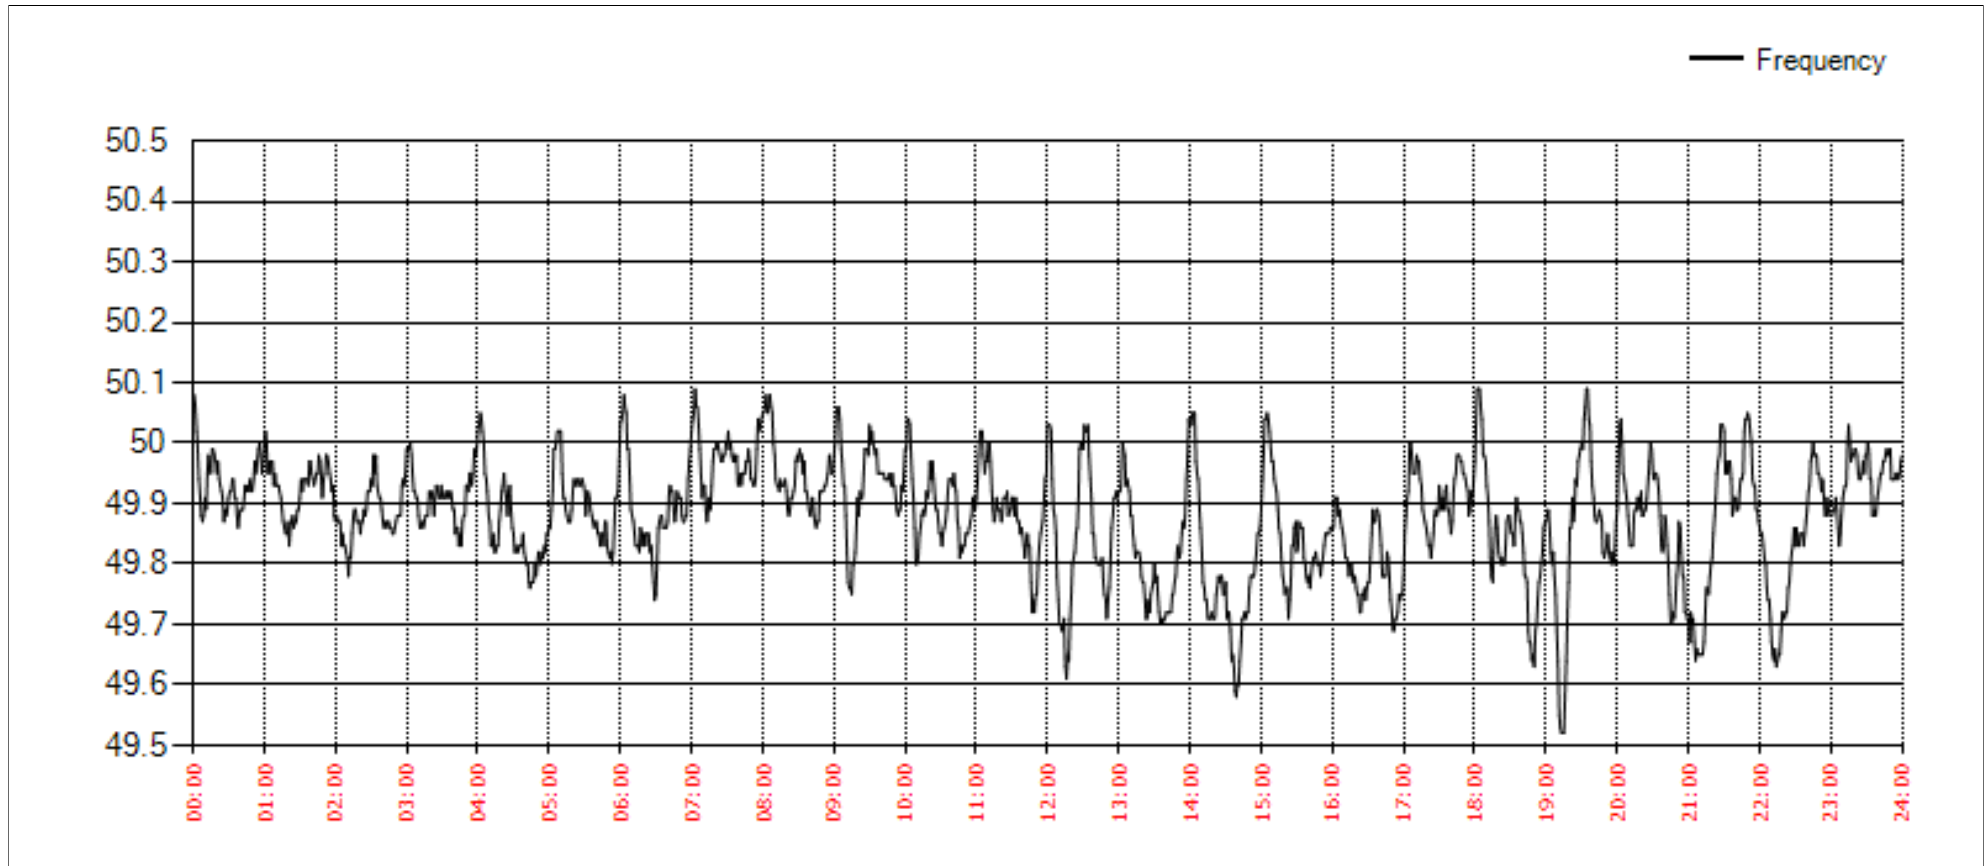

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	53	186	554	793	522	125	626	35	21	0	1387	223
%	0.000	3.681	12.917	38.472	55.069	36.250	8.681	43.472	2.431	1.458	0.000	96.319	15.486

Average Frequency the Day:	49.88	Standard Deviation:	0.095	Frequency Deviation Index:	0.234
-----------------------------------	--------------	----------------------------	--------------	-----------------------------------	--------------

	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE		
	FREQUENCY	TIME	49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY	TIME	
MAX	50.09	07:03:00				9	62	MAX	50.01	8:15
MIN	49.52	19:13:00	0	0	0			MIN	49.66	14:45
Out of IEGC Band	% of Time		56.528					No of Hours		13.56672