


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 10-06-2016

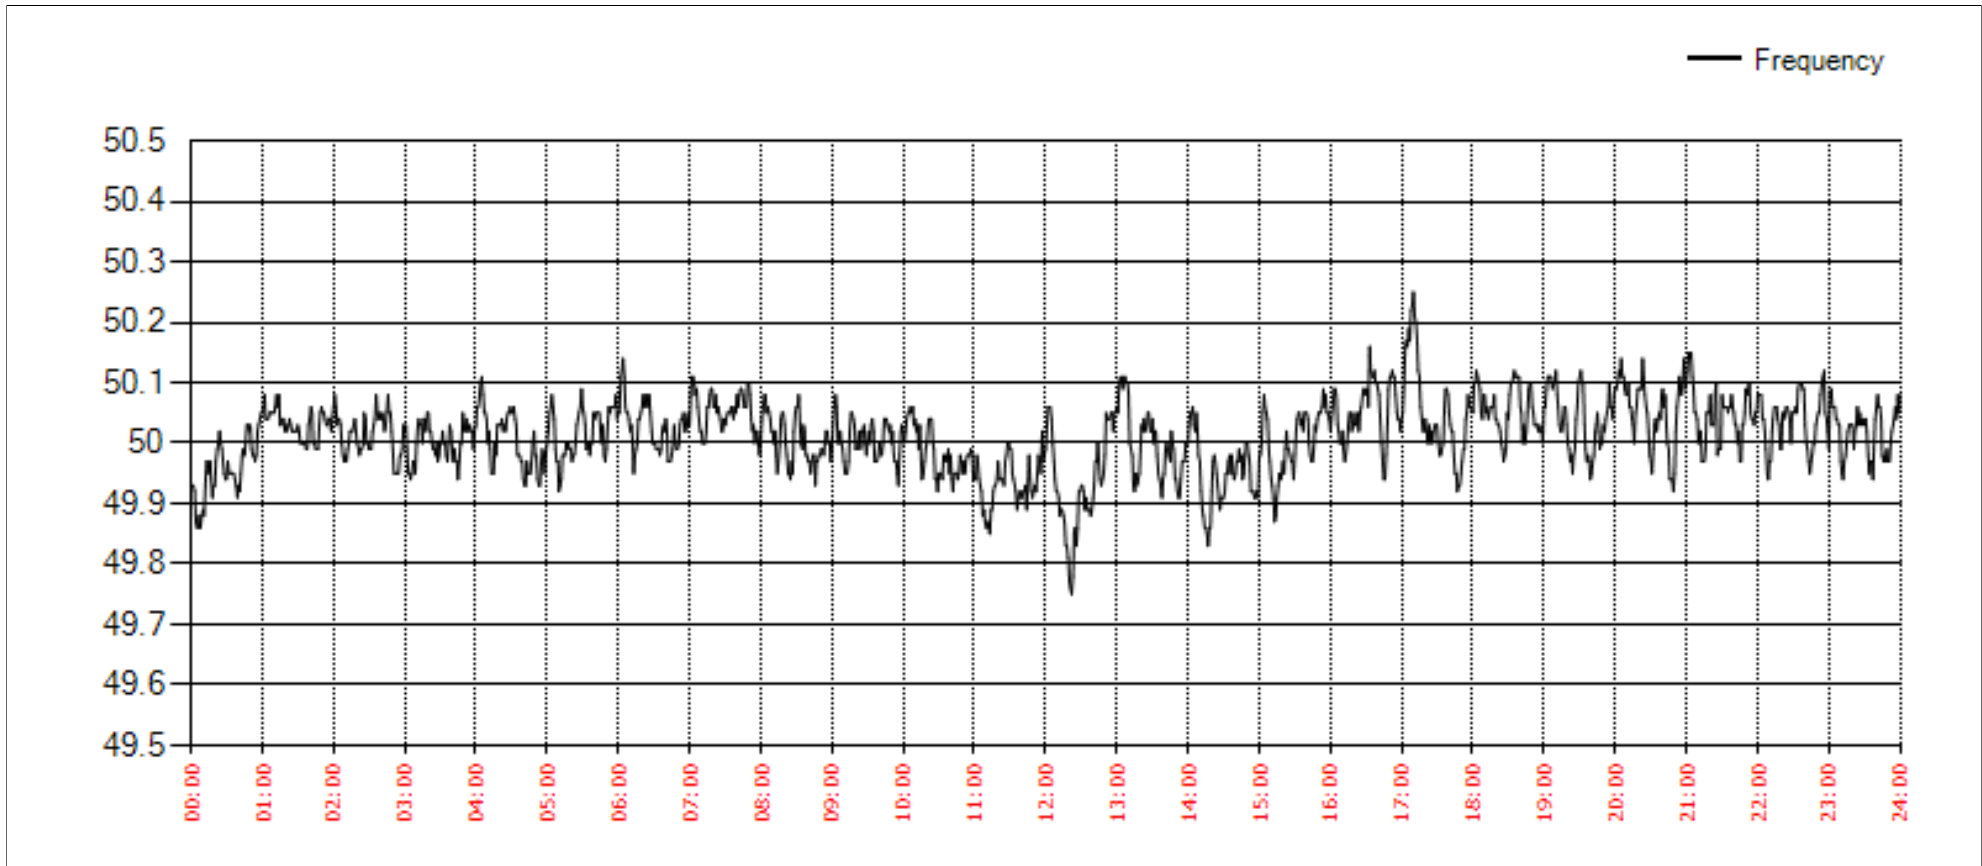

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	0	4	48	52	498	791	1087	202	301	4	1436	638
%	0.000	0.000	0.278	3.333	3.611	34.583	54.931	75.486	14.028	20.903	0.278	99.722	44.306

Average Frequency the Day:	50.01	Standard Deviation:	0.060	Frequency Deviation Index:	0.037
-----------------------------------	--------------	----------------------------	--------------	-----------------------------------	--------------

	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE		
	FREQUENCY	TIME	49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY	TIME	
MAX	50.25	17:10:00					10	MAX	50.17	17:15
MIN	49.75	12:22:00	0	0	0	0		MIN	49.84	12:30
Out of IEGC Band	% of Time		24.514					No of Hours		5.88336