




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

NTPC-VINDHYACHAL:Frequency

National Grid Frequency Profile for

12-Jun-15

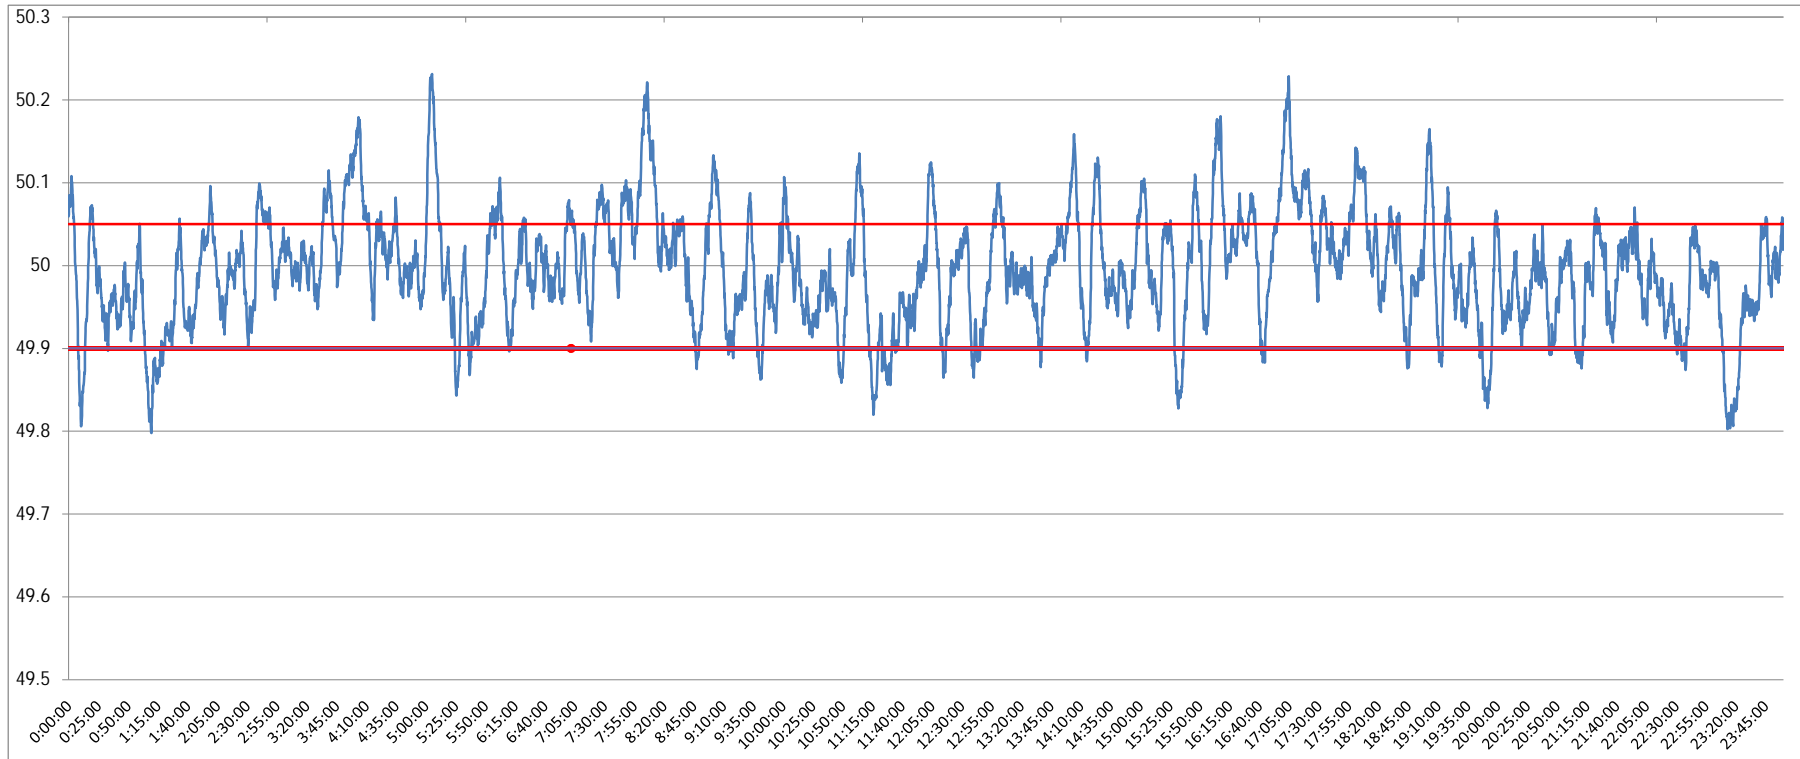

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	8.36	36.34	0.02	8.33	46.38	38.91	5.84	72.08	99.49	34.88	13.25	45.20	28.77	19.56	0.51

Average Frequency	49.99	Frequency Variation Index :	0.048	Standard Deviation :	0.069
-------------------	-------	-----------------------------	-------	----------------------	-------

Instantaneous Frequency		
Max	50.23	5:05:10
Min	49.80	1:09:30

15 minute average Frequency		
Max	50.143	8:15:00
Min	49.876	11:30:00

No. of excursion above 50.03 Hz	114
No. of excursion below 49.97 Hz	125
No. of excursion above 50.00 Hz	153
No. of excursion below 50.00 Hz	151

Average time freq remains below 49.97 per excursion	0:04:11	Average time frequency remains above 50.03 per excursion	0:03:38
---	---------	--	---------