




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

29-Nov-15

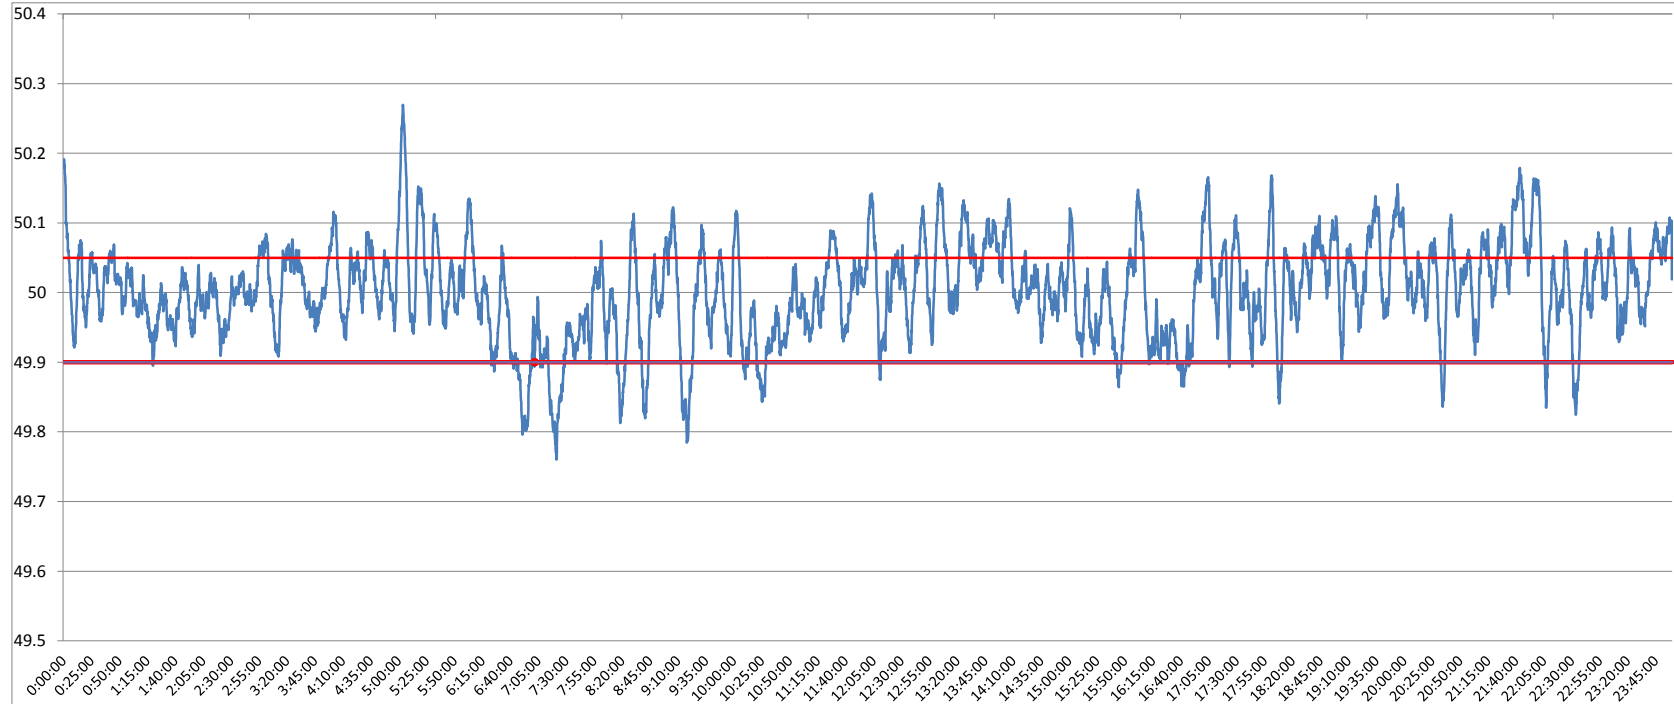

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	7.00	29.91	0.24	6.76	41.20	44.48	7.04	68.72	99.72	35.23	17.03	51.72	34.86	24.28	0.28

Average Frequency	50.00	Frequency Variation Index :	0.048	Standard Deviation :	0.069
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
Max	50.27	5:03:50
Min	49.76	7:21:30

15 minute average Frequency		
Max	50.105	22:00:00
Min	49.839	7:30:00

No. of excursion above 50.03 Hz	151
No. of excursion below 49.97 Hz	113
No. of excursion above 50.00 Hz	138
No. of excursion below 50.00 Hz	135

Average time freq remains below 49.97 per excursion	0:03:49	Average time frequency remains above 50.03 per excursion	0:03:19
---	---------	--	---------