




**POWER SYSTEM OPERATION CORPORATION LIMITED**  
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

HISSAR:Frequency

National Grid Frequency Profile for

06-Aug-15

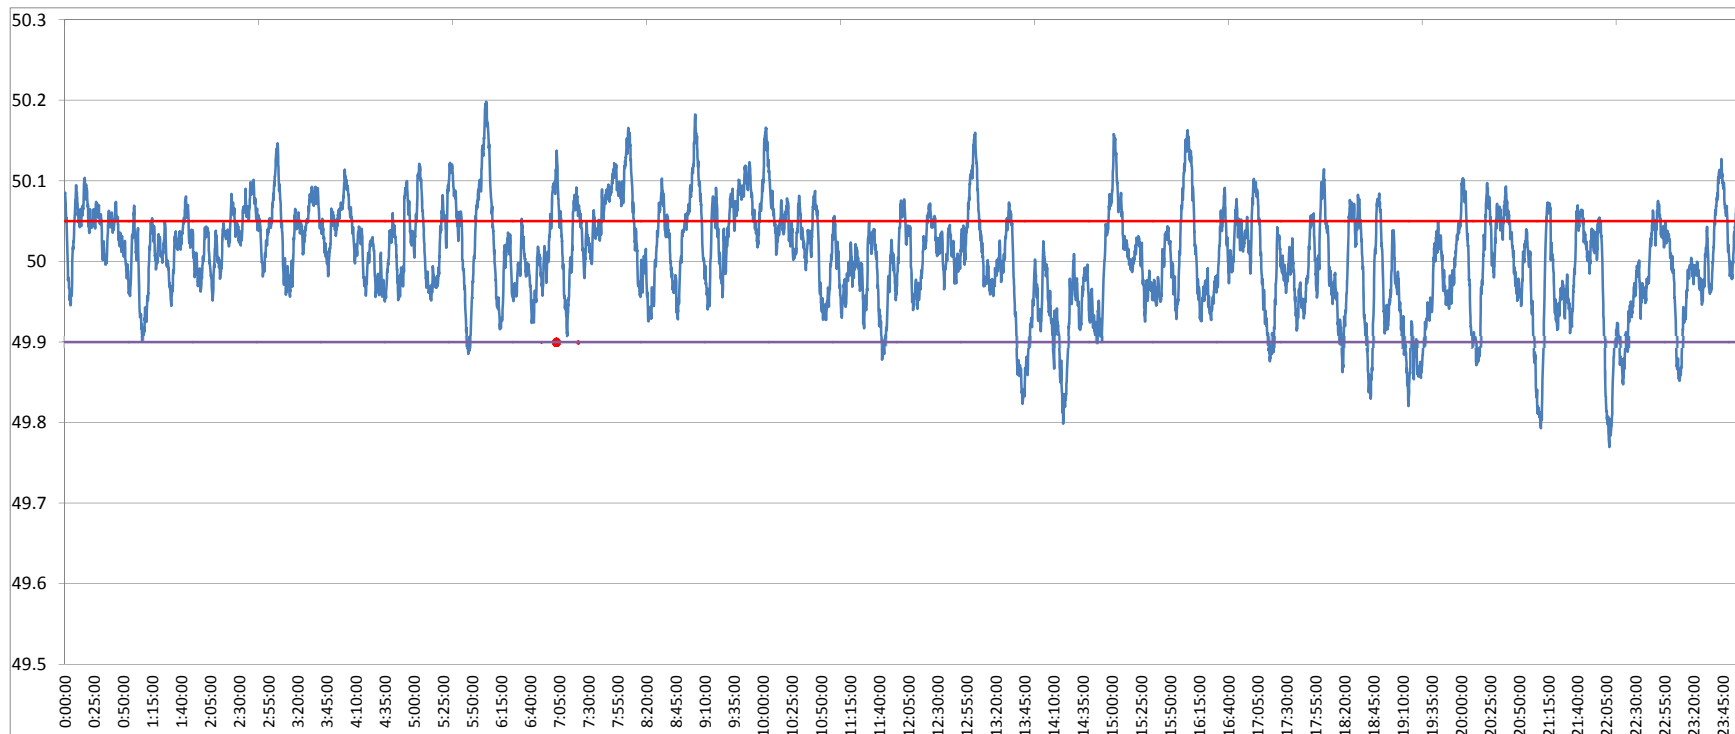

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	6.06	27.07	0.27	5.80	37.29	51.74	4.91	69.00	100.00	34.13	20.08	56.60	38.80	24.93	0.00

<b>Average Frequency</b>	<b>50.01</b>	<b>Frequency Variation Index :</b>	<b>0.041</b>	<b>Standard Deviation :</b>	<b>0.064</b>
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		
Max	50.2	6:02:10
Min	49.77	22:07:20

15 minute average Frequency		
Max	50.092	8:00:00
Min	49.875	22:15:00

No. of excursion above 50.03 Hz	154
No. of excursion below 49.97 Hz	132
No. of excursion above 50.00 Hz	132
No. of excursion below 50.00 Hz	130

Average time freq remains below 49.97 per excursion	0:02:57	Average time frequency remains above 50.03 per excursion	0:03:38
-----------------------------------------------------	---------	----------------------------------------------------------	---------