


POWER SYSTEM OPERATION CORPORATION LIMITED.



SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 08-06-2015

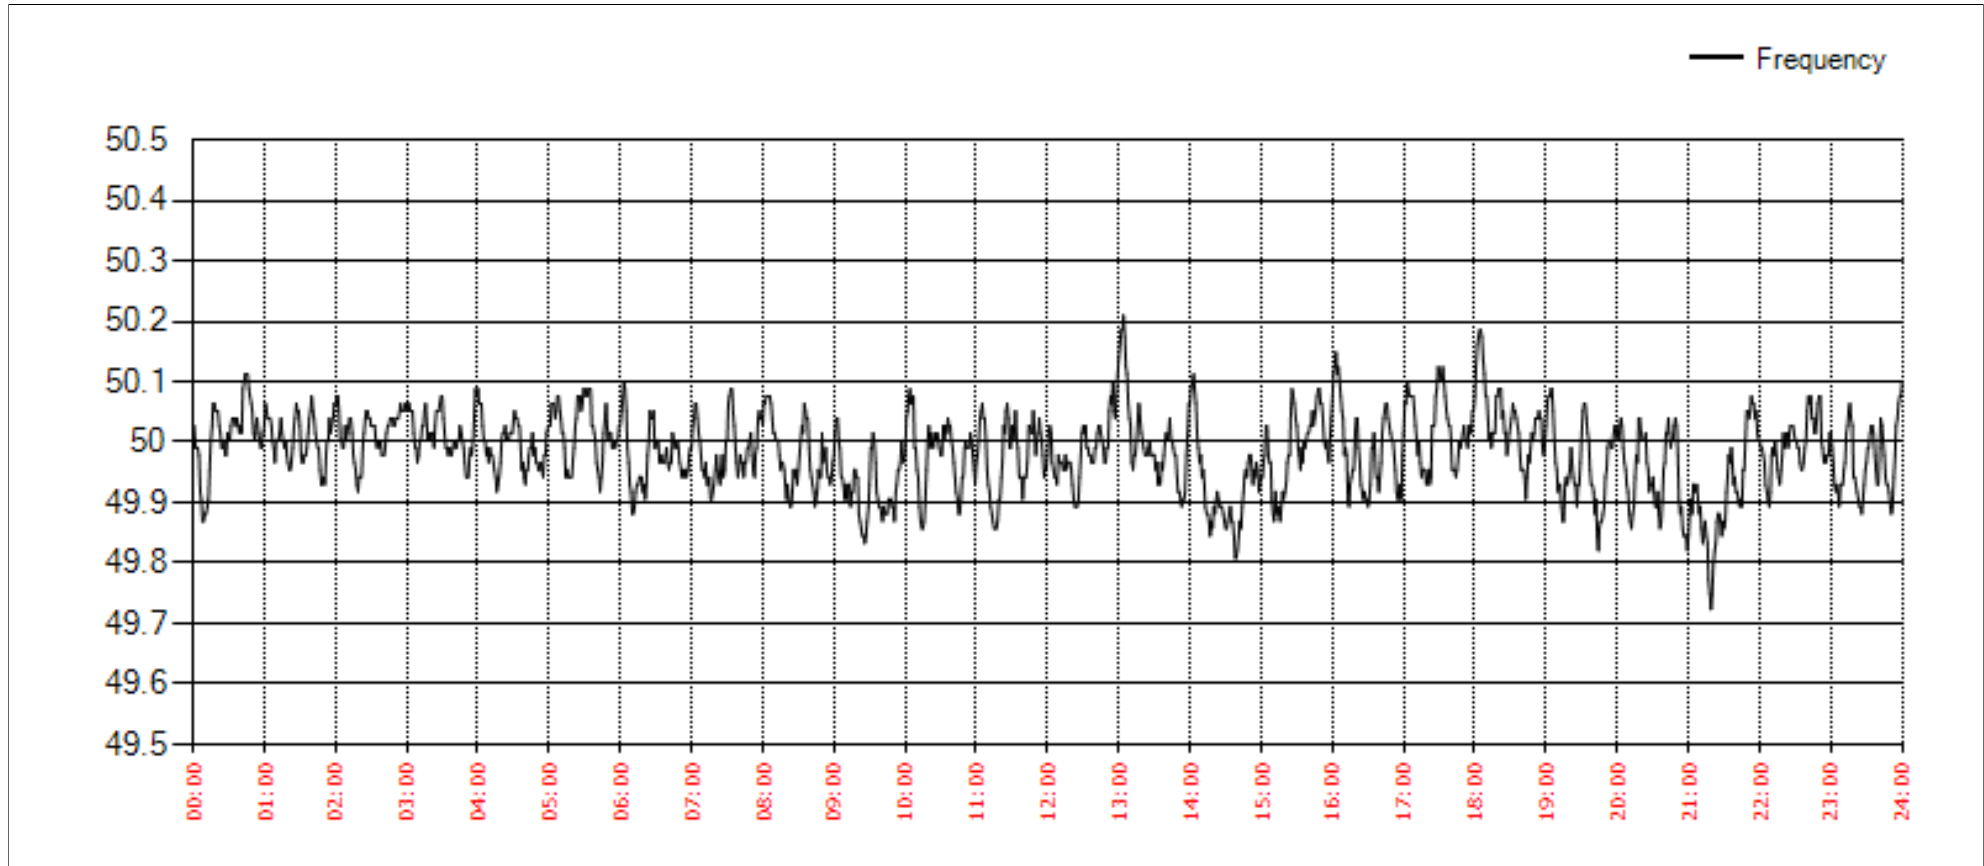

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	0	5	148	153	650	598	1056	192	231	1	1439	534
%	0.000	0.000	0.347	10.278	10.625	45.139	41.528	73.333	13.333	16.042	0.069	99.931	37.083

Average Frequency the Day:			49.98	Standard Deviation:			0.064	Frequency Deviation Index:			0.044
----------------------------	--	--	-------	---------------------	--	--	-------	----------------------------	--	--	-------

	INSTANTENEOUS	
	FREQUENCY	TIME
MAX	50.21	13:04:00
MIN	49.72	21:19:00

EXCURSION BELOW:				
49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ
0	0	0	0	35

	QUATERLY HOURLY AVERAGE	
	FREQUENCY	TIME
MAX	50.10	18:15
MIN	49.82	21:30