


POWER SYSTEM OPERATION CORPORATION LIMITED.

SOUTHERN REGIONAL LOAD DESPATCH CENTRE

FREQUENCY ANALYSIS FOR 09-11-2015

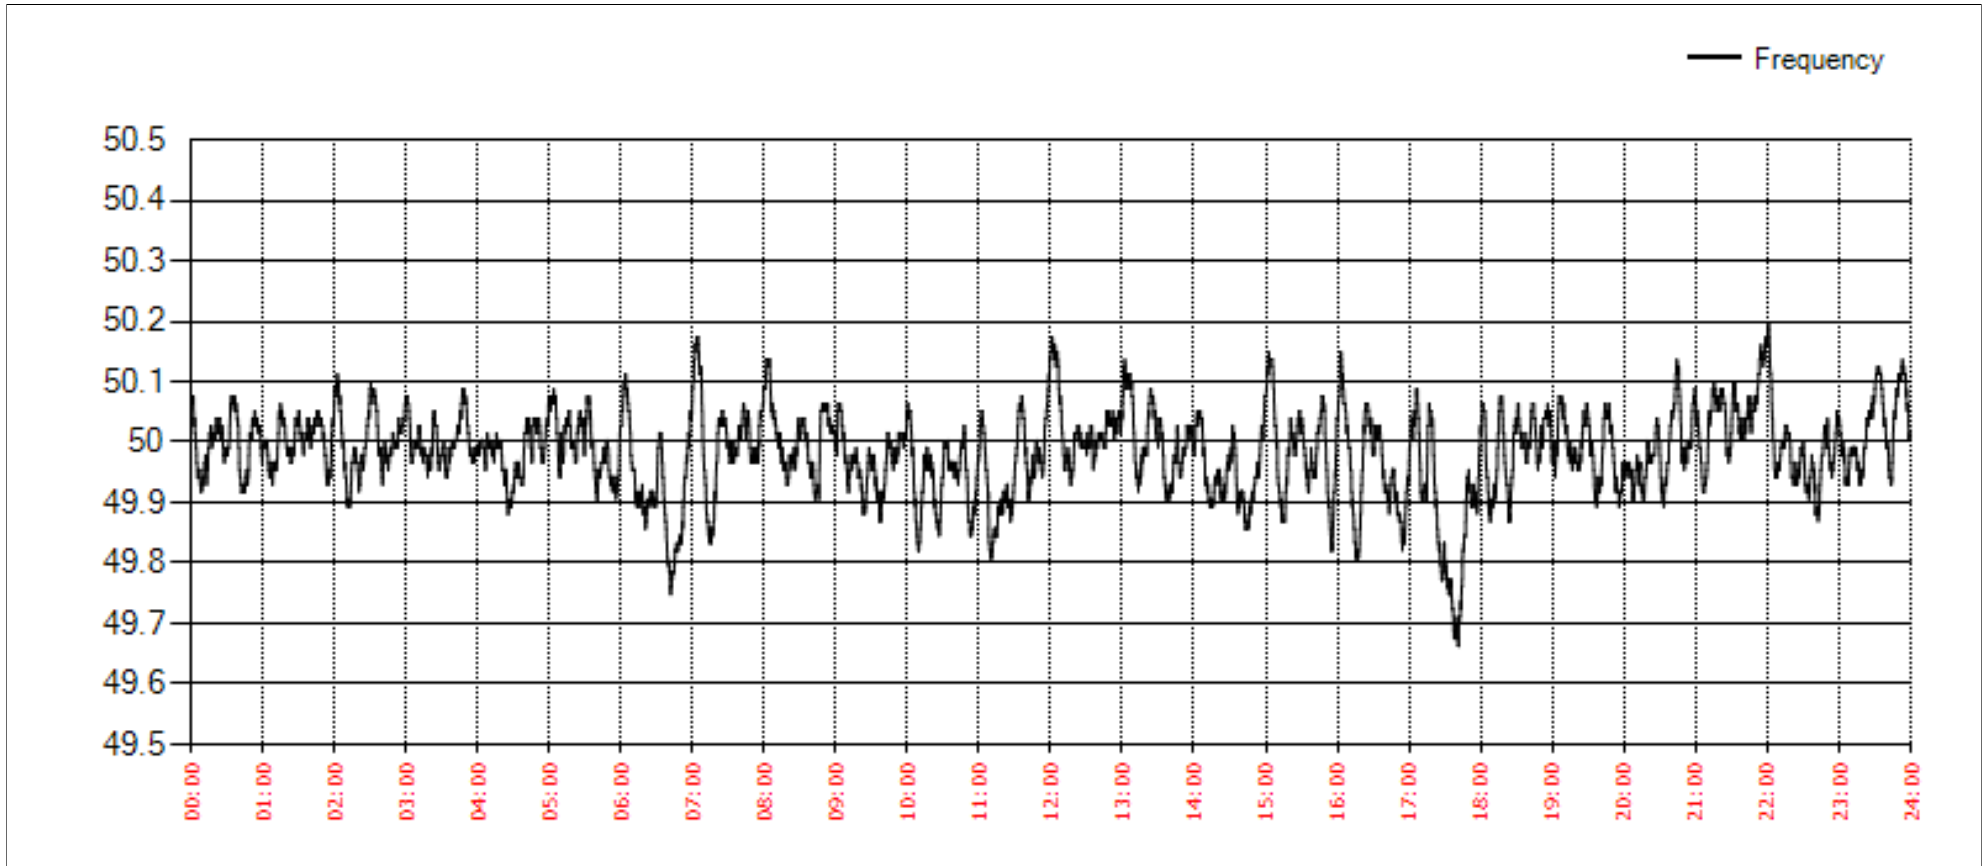

	<49.2	<49.7	49.7 to <49.8	49.8 to <49.9	<49.9	49.9 to <50.0	50.0 to <50.1	>=49.9 to <=50.05	>50.05 to <50.1	>50.05	>50.2	>=49.7 to <=50.2	>=49.97 to <=50.03
Minutes	0	29	111	725	865	4014	3374	6304	1084	1471	0	8611	3161
%	0.000	0.336	1.285	8.391	10.012	46.458	39.051	72.963	12.546	17.025	0.000	99.664	36.586

Average Frequency the Day:			49.98		Standard Deviation:			0.071		Frequency Deviation Index:			0.053	
	INSTANTENEOUS		EXCURSION BELOW:					QUATERLY HOURLY AVERAGE						
	FREQUENCY		TIME		49.0 HZ	49.2 HZ	49.5 HZ	49.7 HZ	49.9 HZ	FREQUENCY		TIME		
MAX	50.20		22:00:40		0	0	0	3	54	MAX		50.10 22:00		
MIN	49.66		17:41:00							MIN		49.73 17:45		
Out of IEGC Band			% of Time			27.037			No of Hours			6.48888		