




**POWER SYSTEM OPERATION CORPORATION LIMITED**  
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

DURGAPUR:Frequency

National Grid Frequency Profile for

11-Jun-17

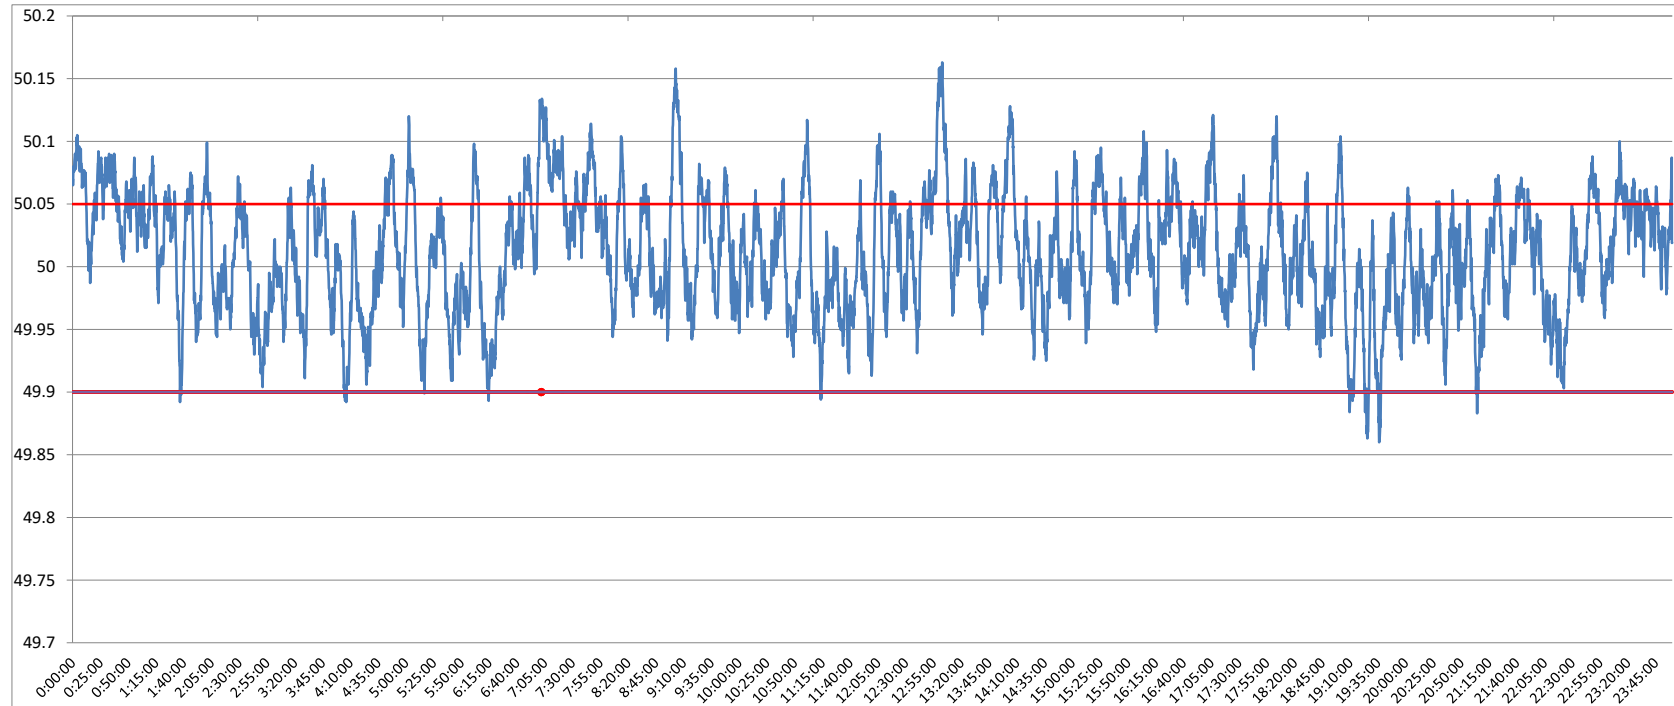

<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2
0	0.00	0.76	20.29	0.00	0.76	40.10	56.71	2.42	76.88	100.00	43.43	20.68	57.62	36.28	22.36	0.00

<b>Average Frequency</b>	<b>50.01</b>	<b>Frequency Variation Index :</b>	<b>0.024</b>	<b>Standard Deviation :</b>	<b>0.048</b>
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency	
Max	50.16 13:02:50
Min	49.86 19:36:10

15 minute average Frequency		
Max	50.097	7:15:00
Min	49.943	19:45:00

No. of excursion above 50.03 Hz	159
No. of excursion below 49.97 Hz	136
No. of excursion above 50.00 Hz	136
No. of excursion below 50.00 Hz	127

Average time freq remains below 49.97 per excursion	0:02:09	Average time frequency remains above 50.03 per excursion	0:03:17
---	---------	--	---------