




POWER SYSTEM OPERATION CORPORATION LIMITED
NATIONAL LOAD DESPATCH CENTRE NEW DELHI

NTPC-VINDHYACHAL:Frequency

National Grid Frequency Profile for 20-Sep-15

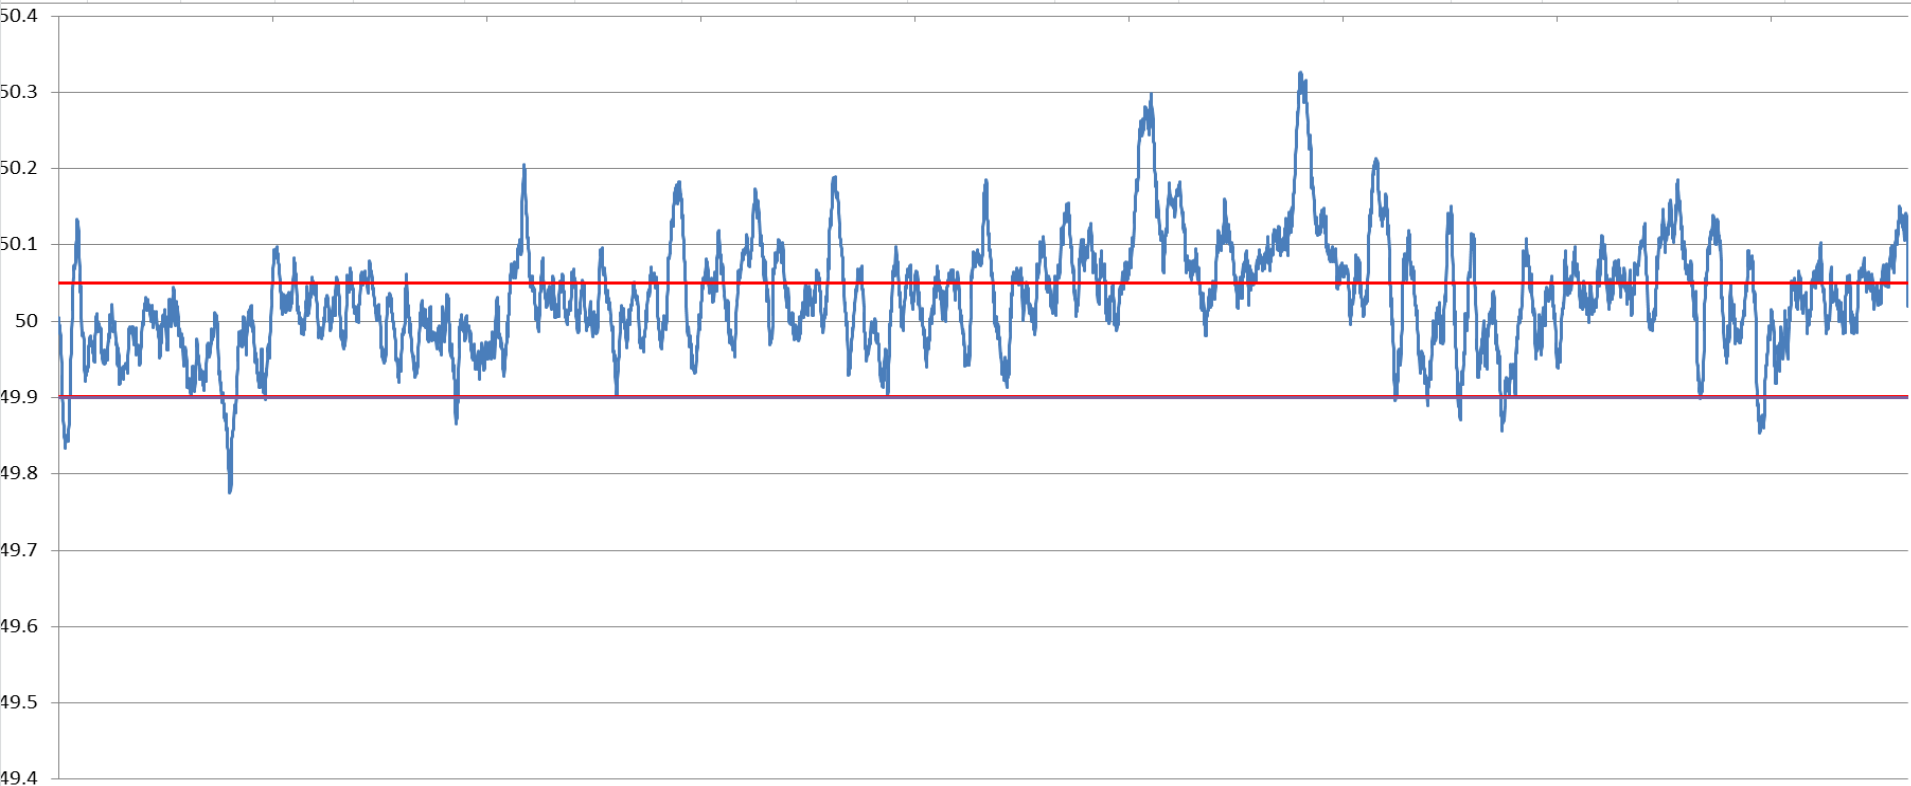

0:00:00	0:25:00	0:50:00	1:15:00	1:40:00	2:05:00	2:30:00	2:55:00	3:20:00	3:45:00	4:10:00	4:35:00	5:00:00	5:25:00	5:50:00	6:15:00	6:40:00	7:05:00	7:30:00	7:55:00	8:20:00	8:45:00	9:10:00	9:35:00	10:00:00	10:25:00	10:50:00	11:15:00	11:40:00	12:05:00	12:30:00	12:55:00	13:20:00	13:45:00	14:10:00	14:35:00	15:00:00	15:25:00	15:50:00	16:15:00	16:40:00	17:05:00	17:30:00	17:55:00	18:20:00	18:45:00	19:10:00	19:35:00	20:00:00	20:25:00	20:50:00	21:15:00	21:40:00	22:05:00	22:30:00	22:55:00	23:20:00	23:45:00
<49.2	<49.7	<49.90	<49.97	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	49.90-50.05	49.7-50.2	49.97-50.03	50.05-50.1	>50	>50.03	>50.05	>50.2																																									
0	0.00	2.14	17.49	0.13	2.01	30.16	53.21	12.49	60.30	98.00	33.15	23.10	67.63	49.36	37.56	2.00																																									

Average Frequency	50.03	Frequency Variation Index :	0.062	Standard Deviation :	0.071
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency		15 minute average Frequency		No. of excursion above 50.03 Hz	135
Max	50.33 16:06:30	Max	50.257 16:15:00	No. of excursion below 49.97 Hz	82
Min	49.77 2:13:00	Min	49.900 2:15:00	No. of excursion above 50.00 Hz	141
				No. of excursion below 50.00 Hz	135

Average time freq remains below 49.97 per excursion	0:03:04	Average time frequency remains above 50.03 per excursion	0:05:16
--	----------------	---	----------------