




POWER SYSTEM OPERATION CORPORATION LIMITED
 NATIONAL LOAD DESPATCH CENTRE NEW DELHI

National Grid Frequency Profile for 27.05.14

RENGALI:Frequency

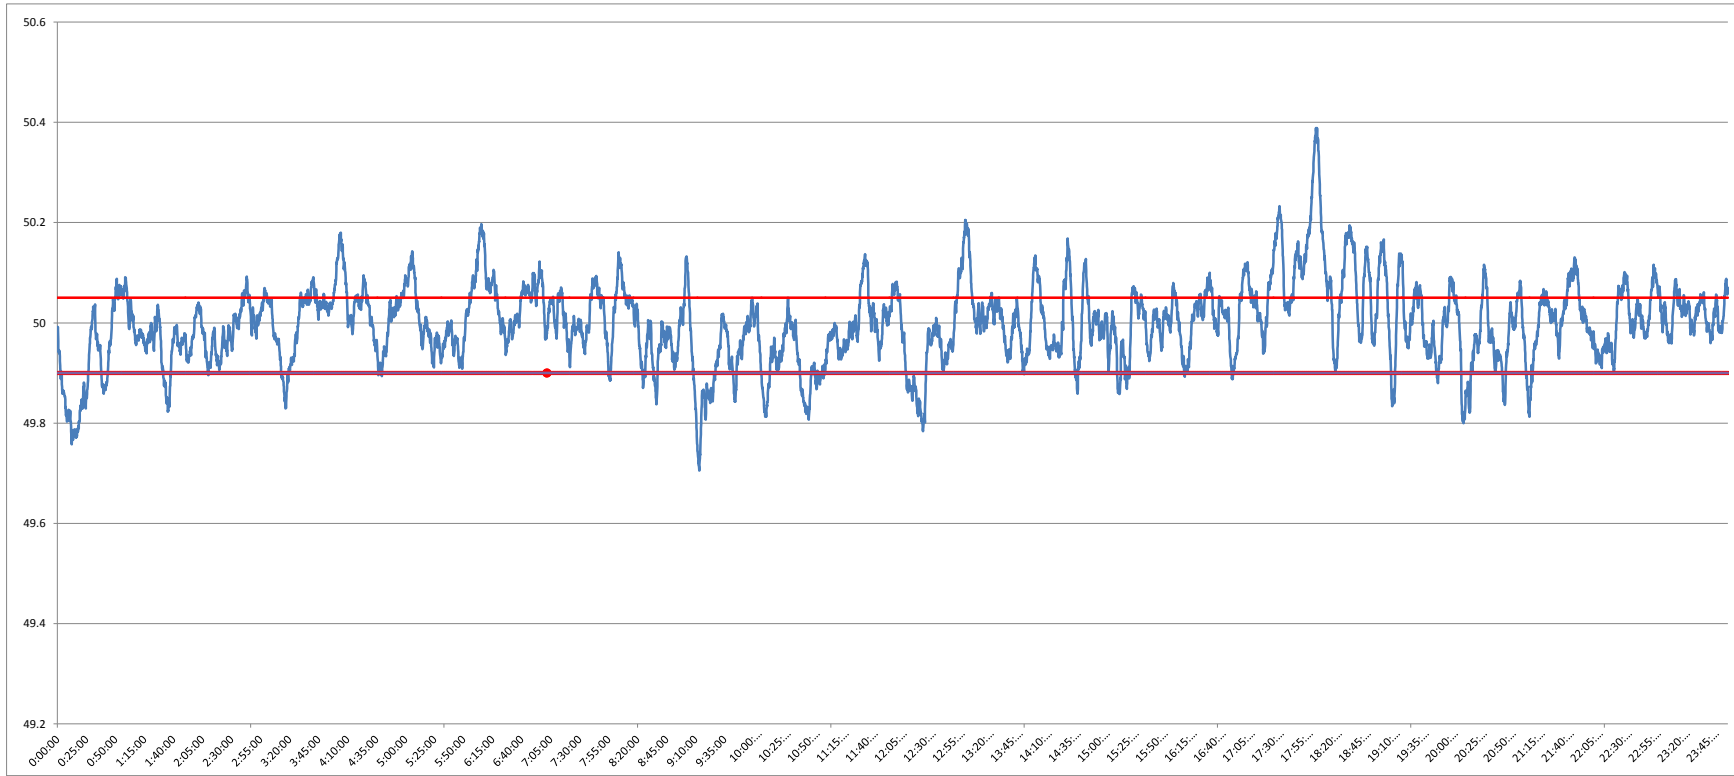

<49.2	<49.7	49.7-49.8	49.8-49.9	49.9-50.0	50.0-50.1	50.1-50.2	>50.2	<49.90	49.90-50.05	>50.05	50.05-50.1	49.7-50.2	49.97-50.03
0	0.00	0.83	9.29	40.94	40.37	7.65	0.92	10.13	66.63	23.24	14.73	99.08	31.93

Average Frequency	50.00	Frequency Variation Index :	0.065	Standard Deviation :	0.081
--------------------------	--------------	------------------------------------	--------------	-----------------------------	--------------

Instantaneous Frequency			15 minute average Frequency		
MAX	50.389	18:04:40	Max	50.241	18:15:00
Min	49.71	9:13:10	Min	49.846	0:15:00